



**COMBINATION GUTTER AND CURB**

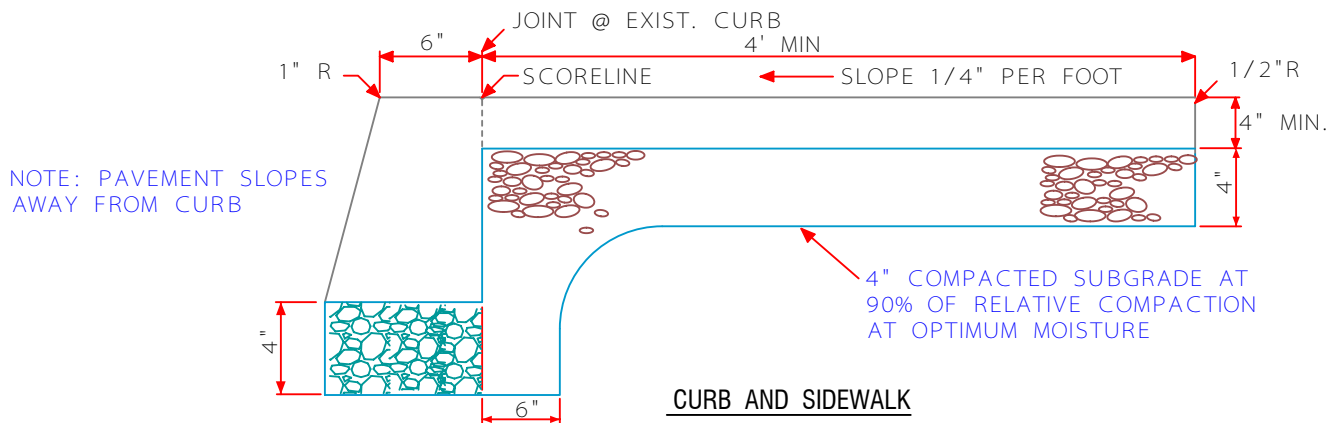

**CURB AND SIDEWALK**

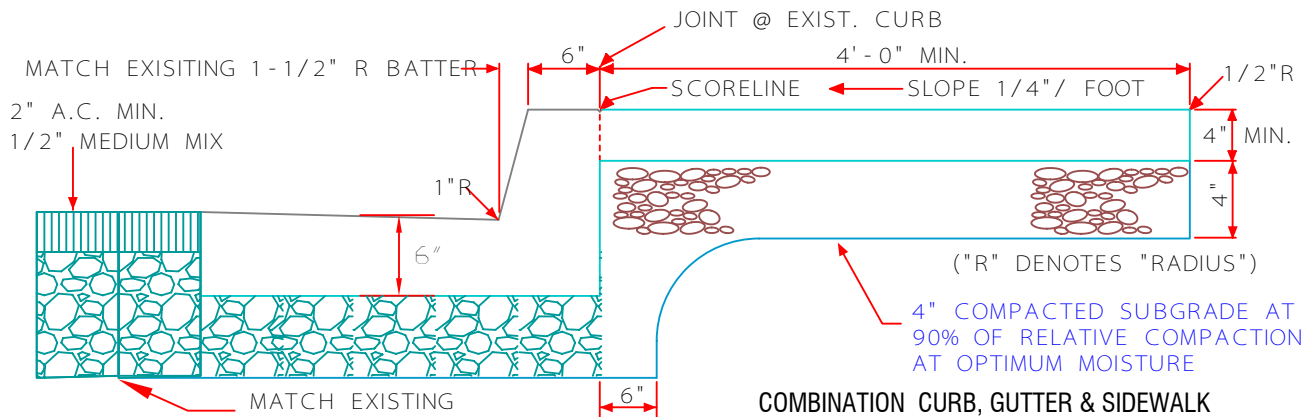

**COMBINATION CURB, GUTTER & SIDEWALK**

**NOTES:**

1. ALL WORK AND MATERIAL SHALL CONFORM TO CITY OF SEASIDE STANDARD SPECIFICATIONS FOR PUBLIC IMPROVEMENTS.
2. CONCRETE SHALL MEET 3,000 PSI IN 28-DAY REQUIREMENT
3. CONCRETE SHALL BE CLASS 3, OR BETTER, PER SECTION 90 - 10, STANDARD SPECIFICATIONS CALIFORNIA DEPARTMENT OF TRANSPORTATION
4. WORK SHALL BE IN ACCORDANCE WITH SECTION 73, CONCRETE CURBS AND SIDEWALKS, STANDARD SPECIFICATIONS, CALIFORNIA DEPARTMENT OF TRANSPORTATION
5. CLASS 2 AGGRAGATE BASE, 1 1/2 DIAMETER 6" DEPTH. RELATIVE COMPACTION AT 95%
6. ALL CONCRETE SURFACES WHICH HAVE BEEN MARKED OR DEFACED WILL NOT BE ACCEPTED.
7. SURFACES SHALL BE BROOM FINISHED. BROOM SURFACE TRANSVERSELY TO LINE OF TRAFFIC. ADD WATER TO SURFACE AS NEEDED
8. EXPANSION JOINT/ SCORELINE - SEE DETAIL S - 104.
9. CURB, GUTTER, SIDEWALK AND DRIVEWAY REMOVAL SHALL BE AT SCORE LINES. LIMITS OF REMOVAL DETERMINED BY CITY INSPECTOR



**PUBLIC WORKS DEPARTMENT**

Drawing File No. **S-101**

APPROVED: \_\_\_\_\_

TIMOTHY P. O'HALLORAN, CITY ENGINEER - RCE NO. 49501

**STANDARD DRAWING FOR  
NEW CURB, GUTTER  
& SIDEWALK**

CITY COUNCIL RESOLUTION NO: